
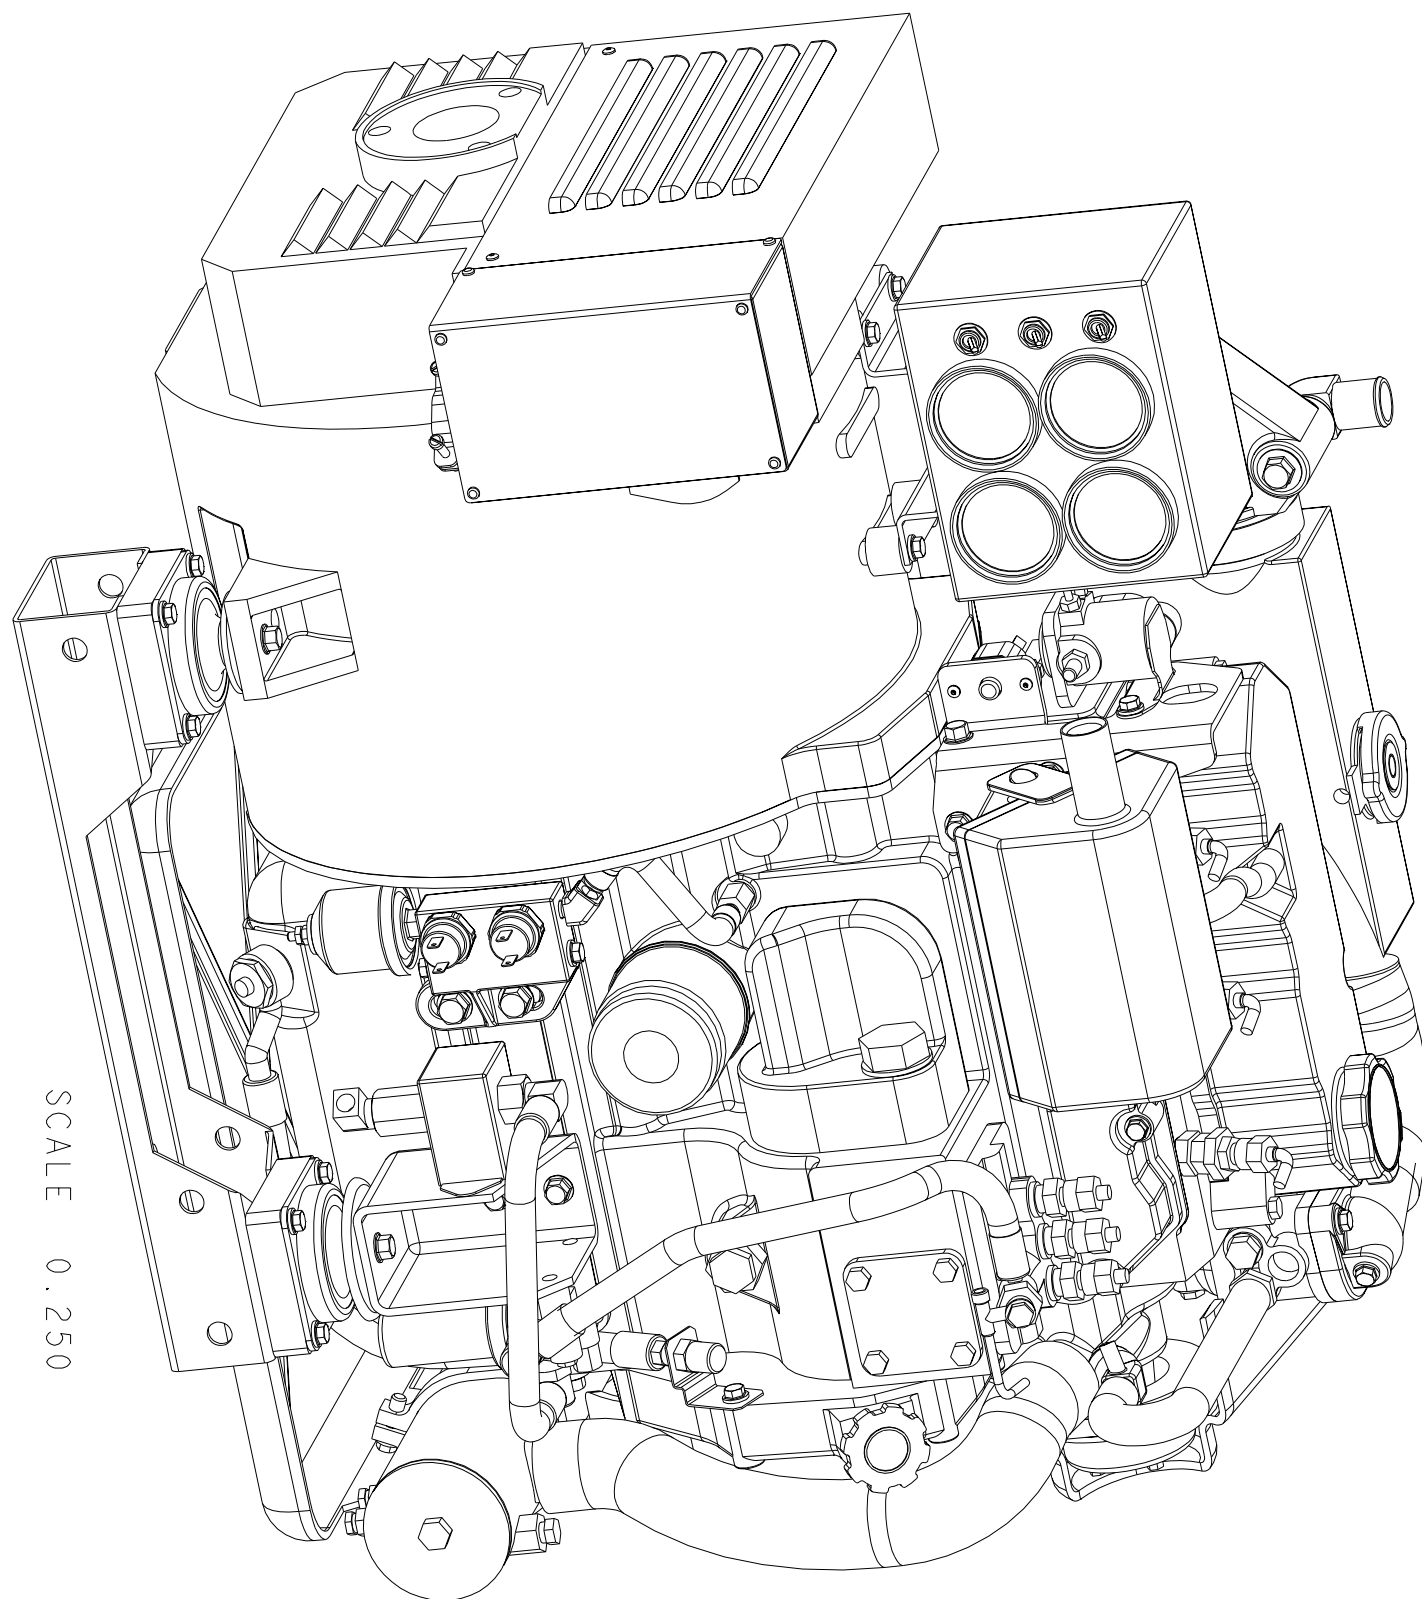
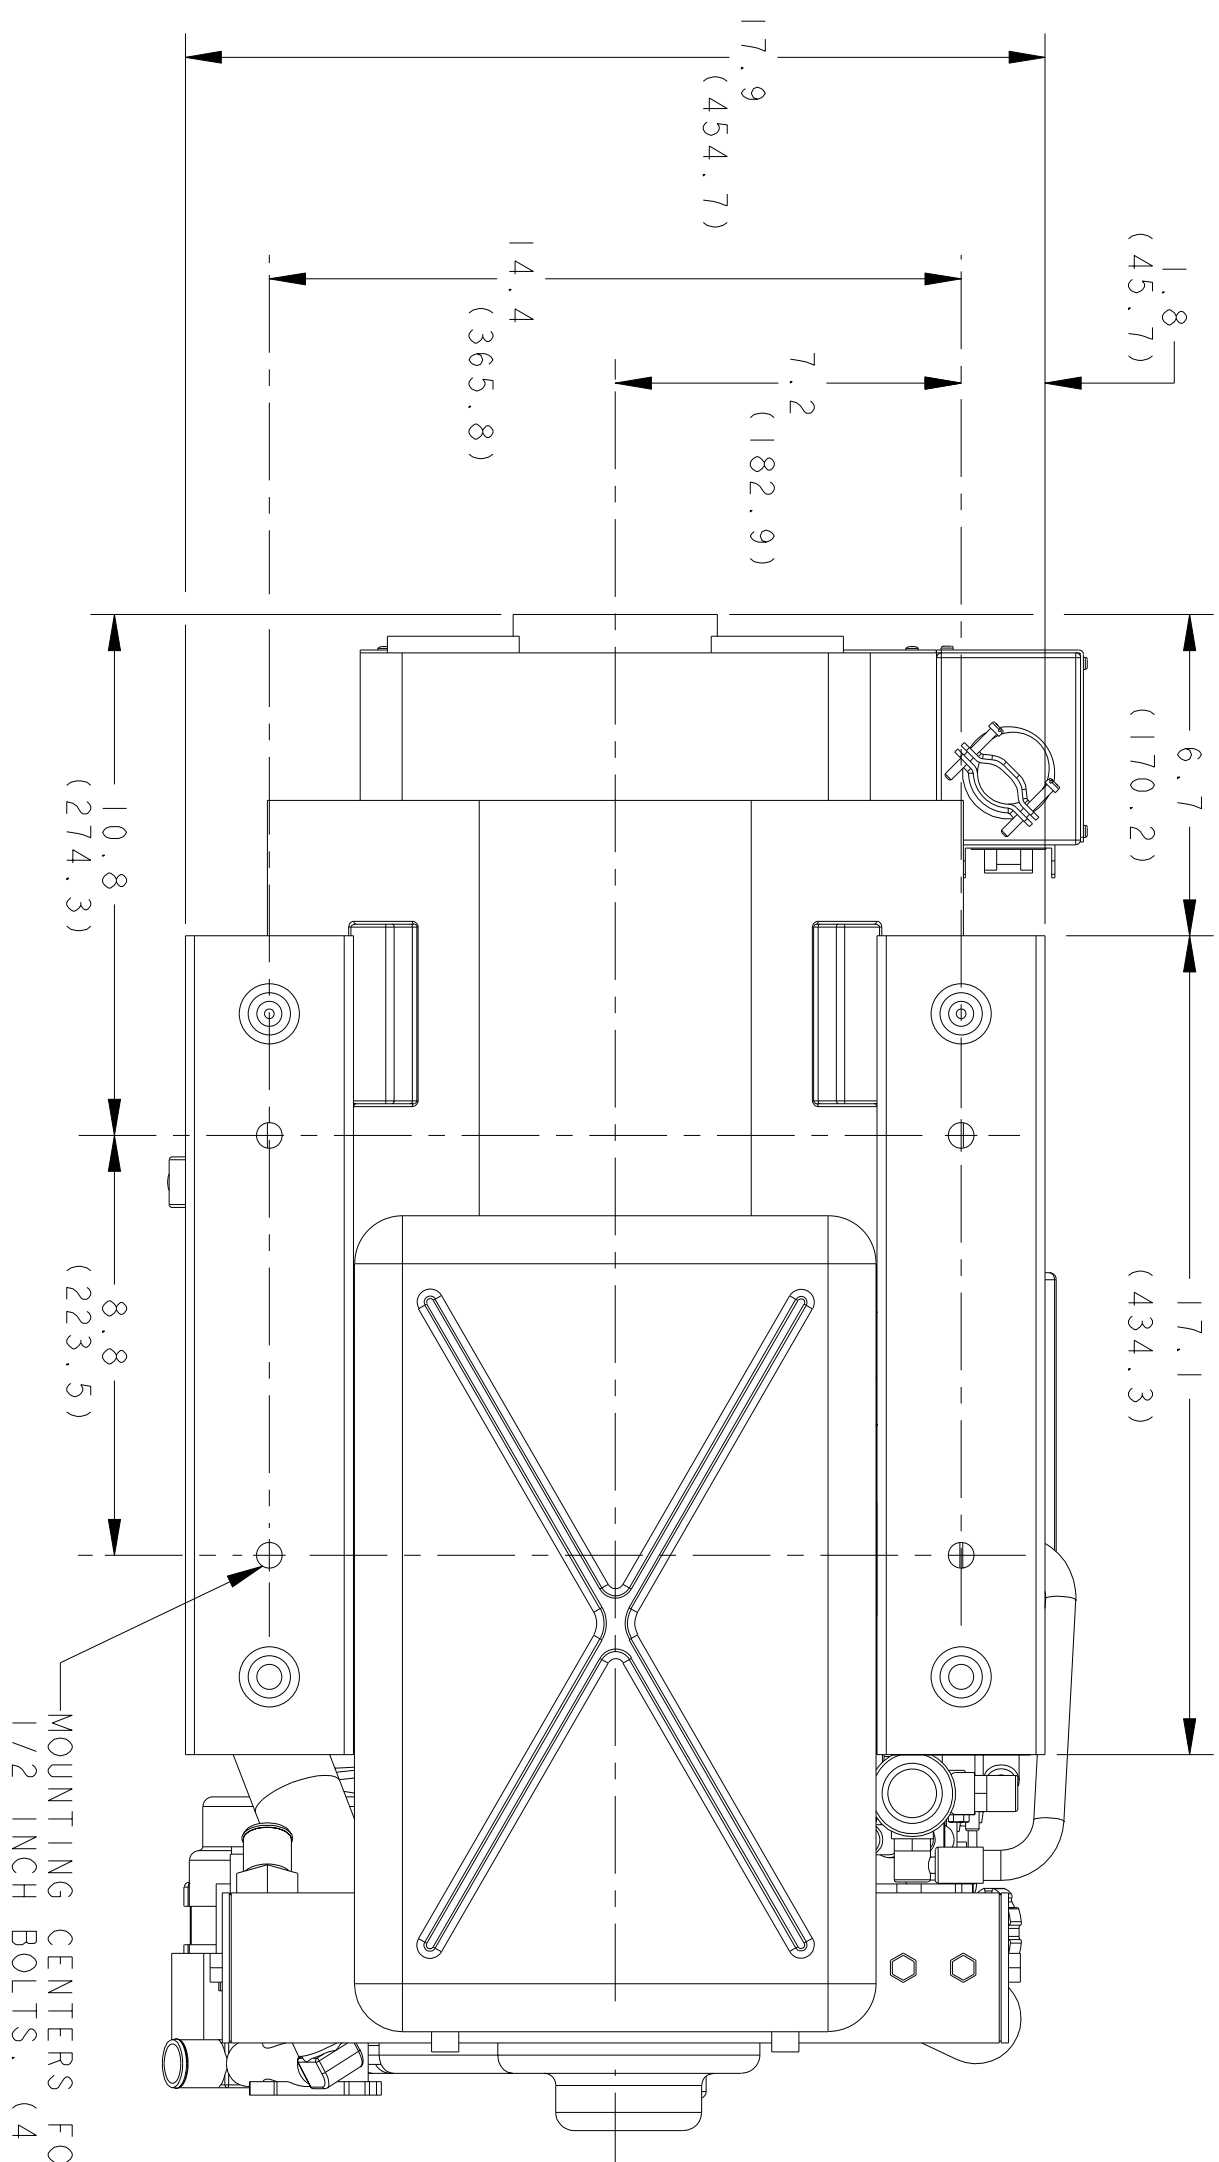
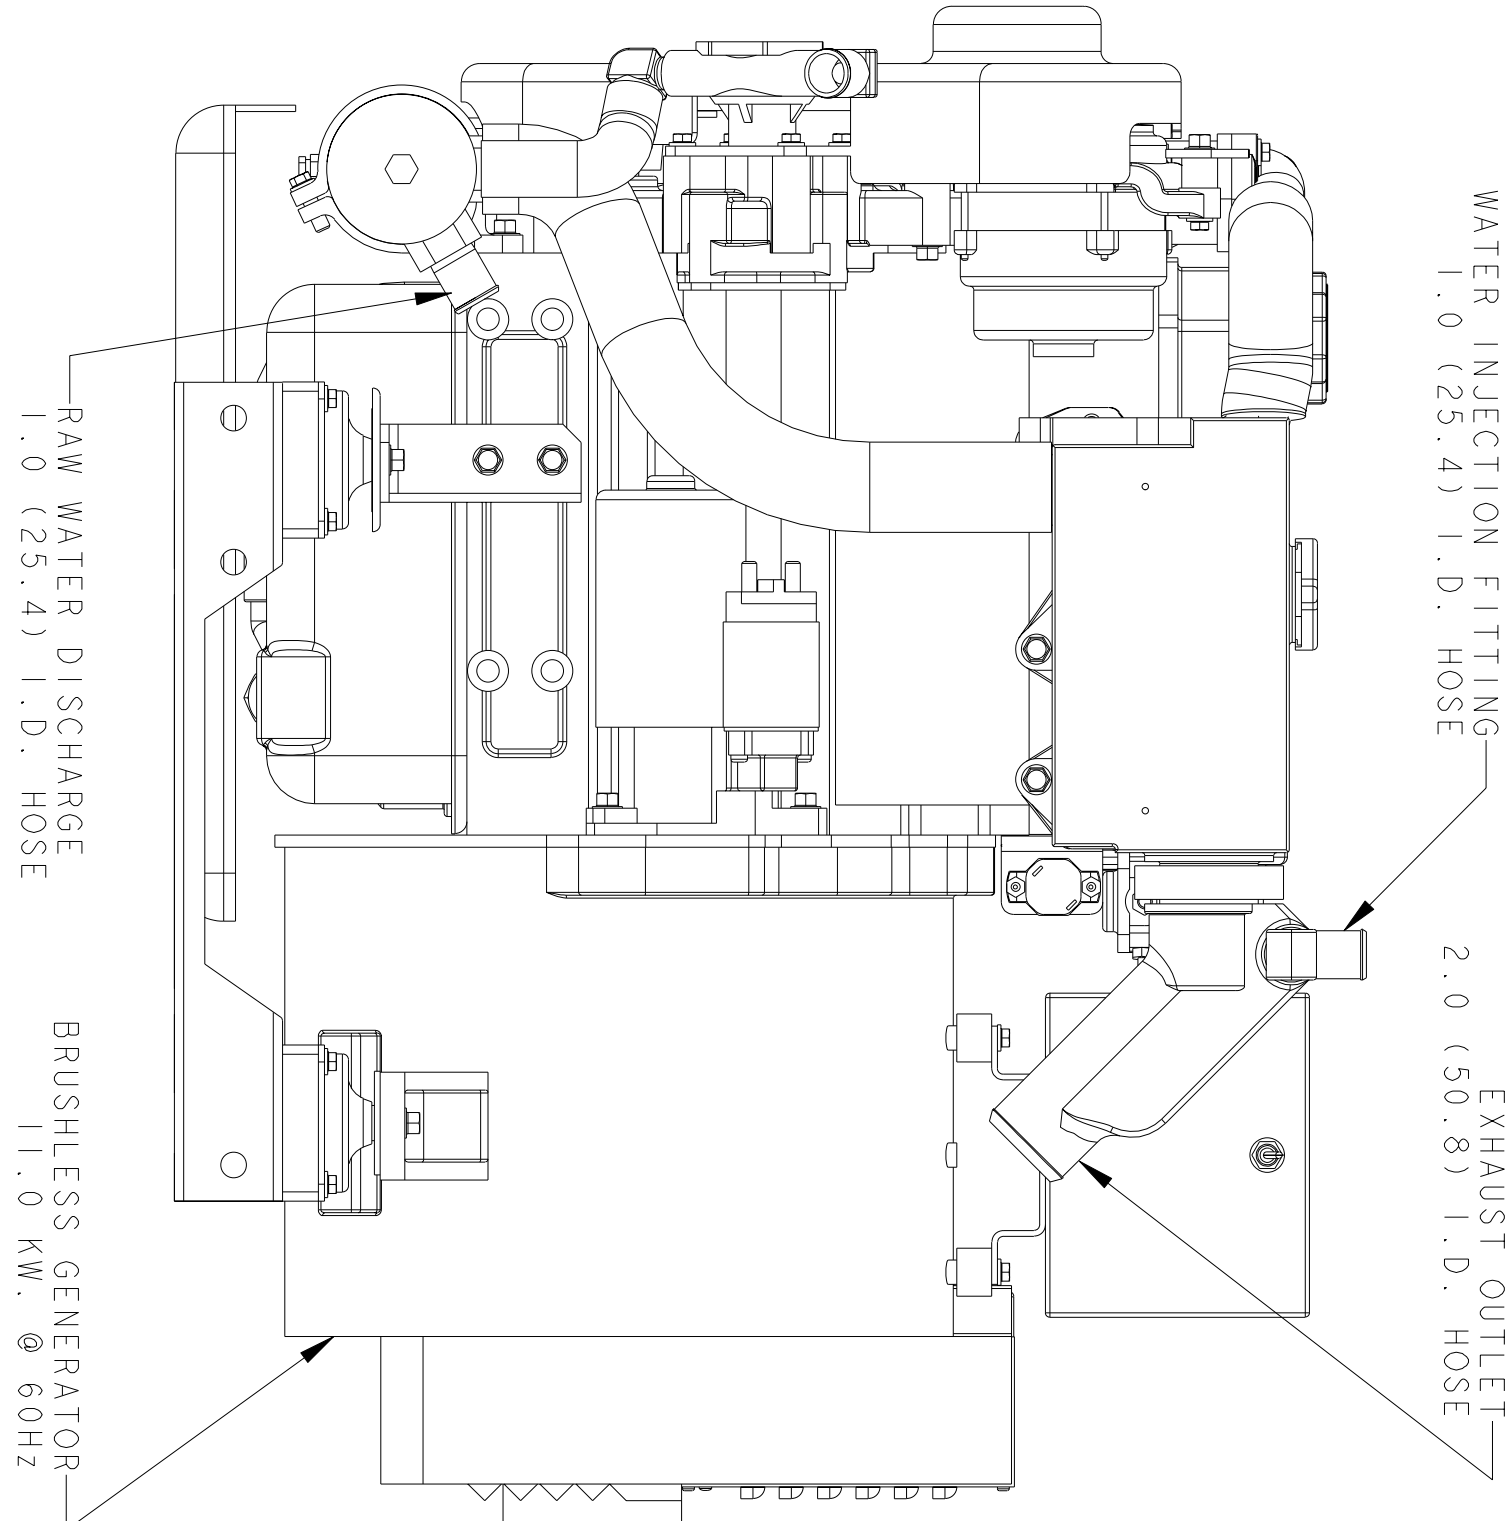
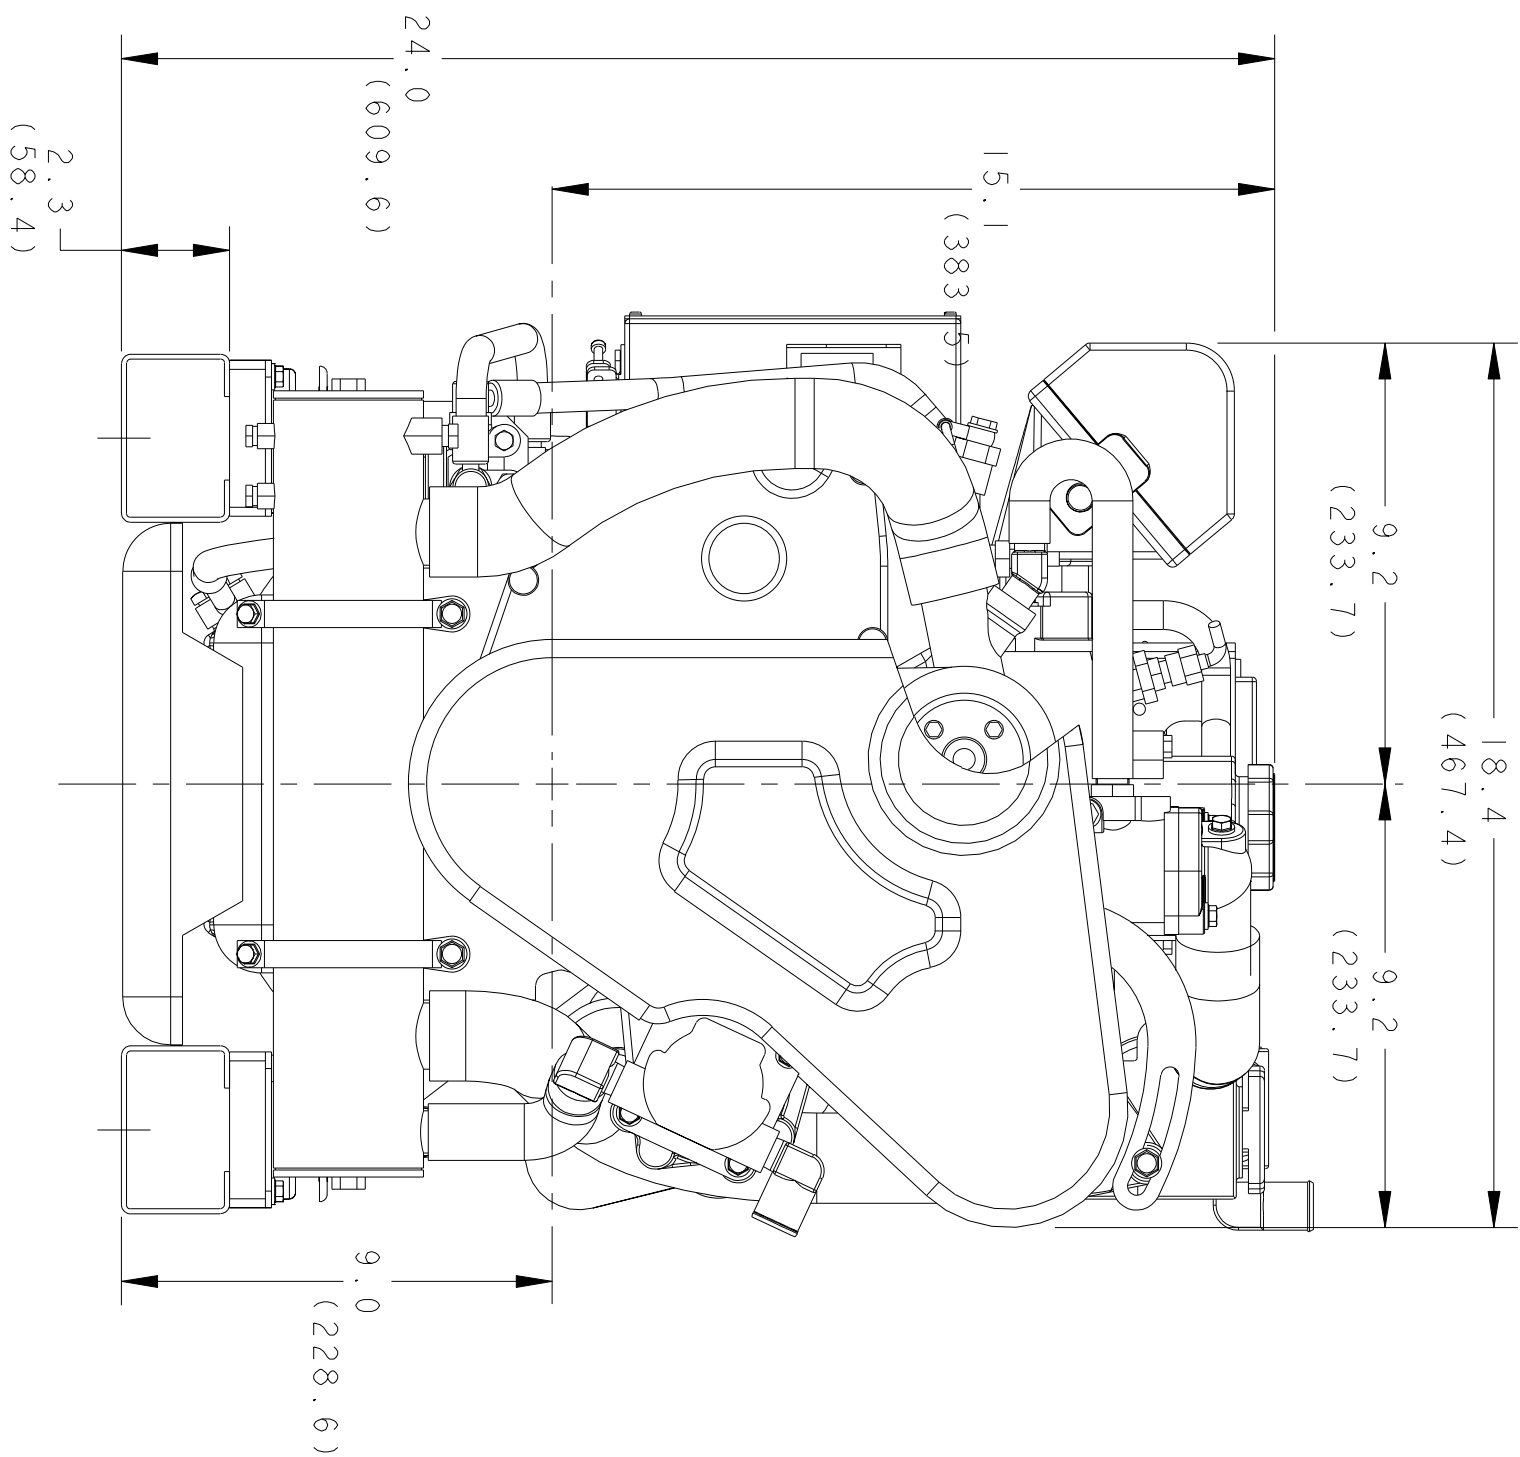
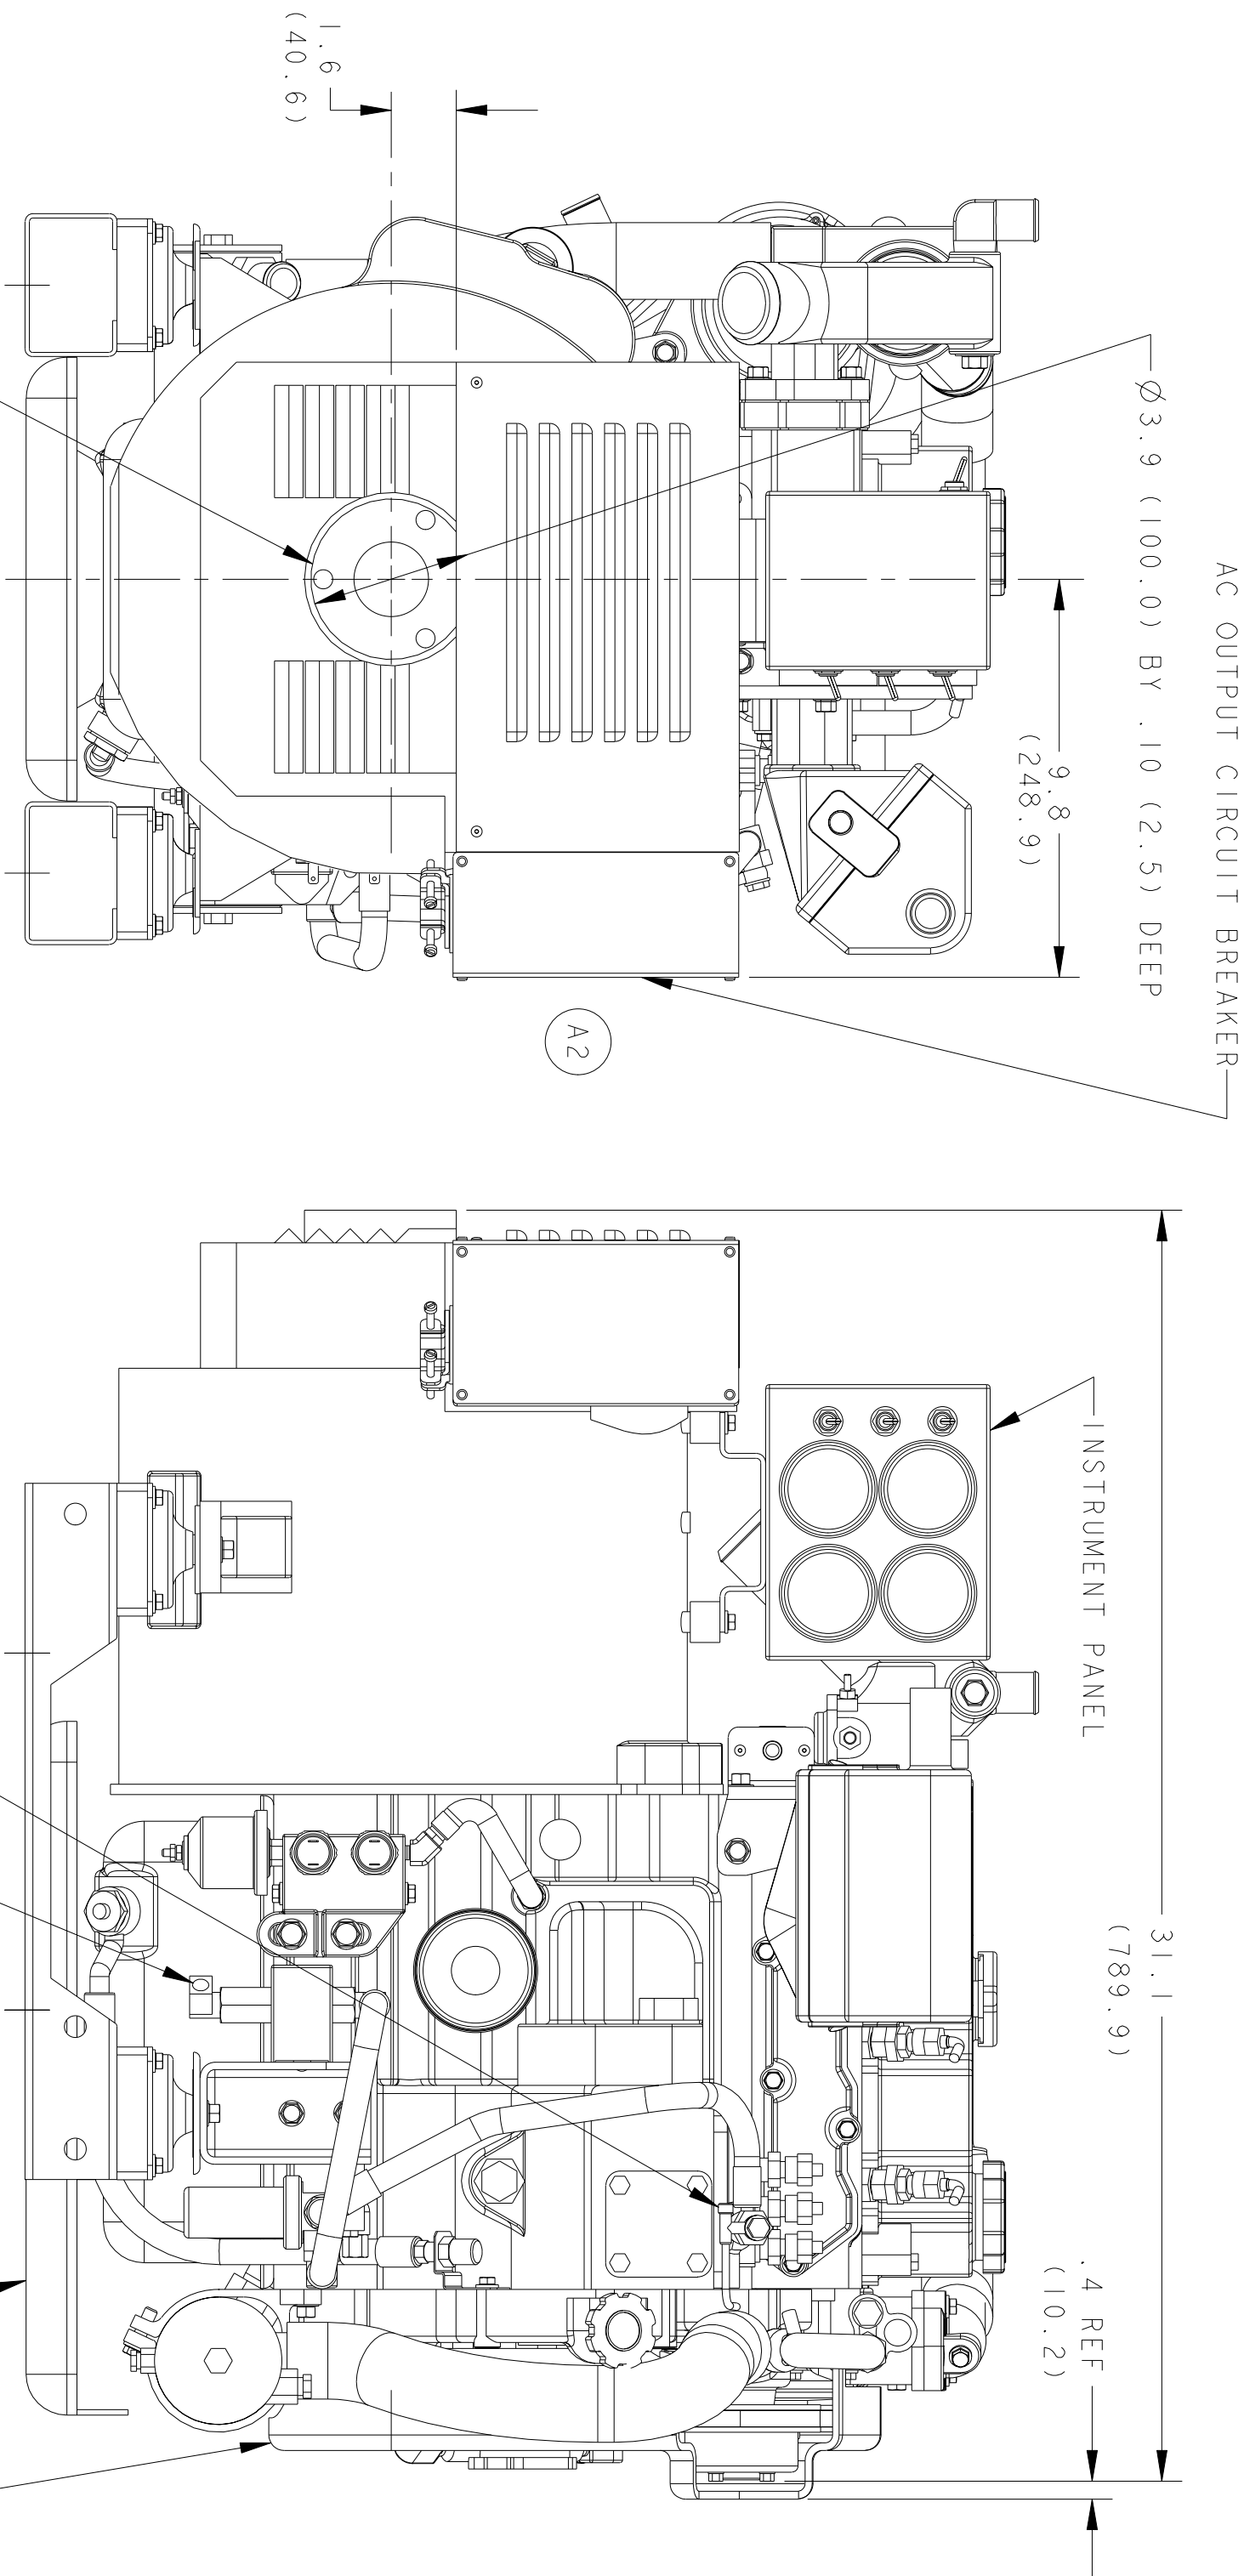


ECO NO.	DATE	REV.	REVISION RECORD	AUTH.	DR. BY
4364	1-11-2000	A	1. MODEL NUMBER 10 B7DA WAS 11 B7DA 2. REVISED BREAKER BOX MOUNTING		JM

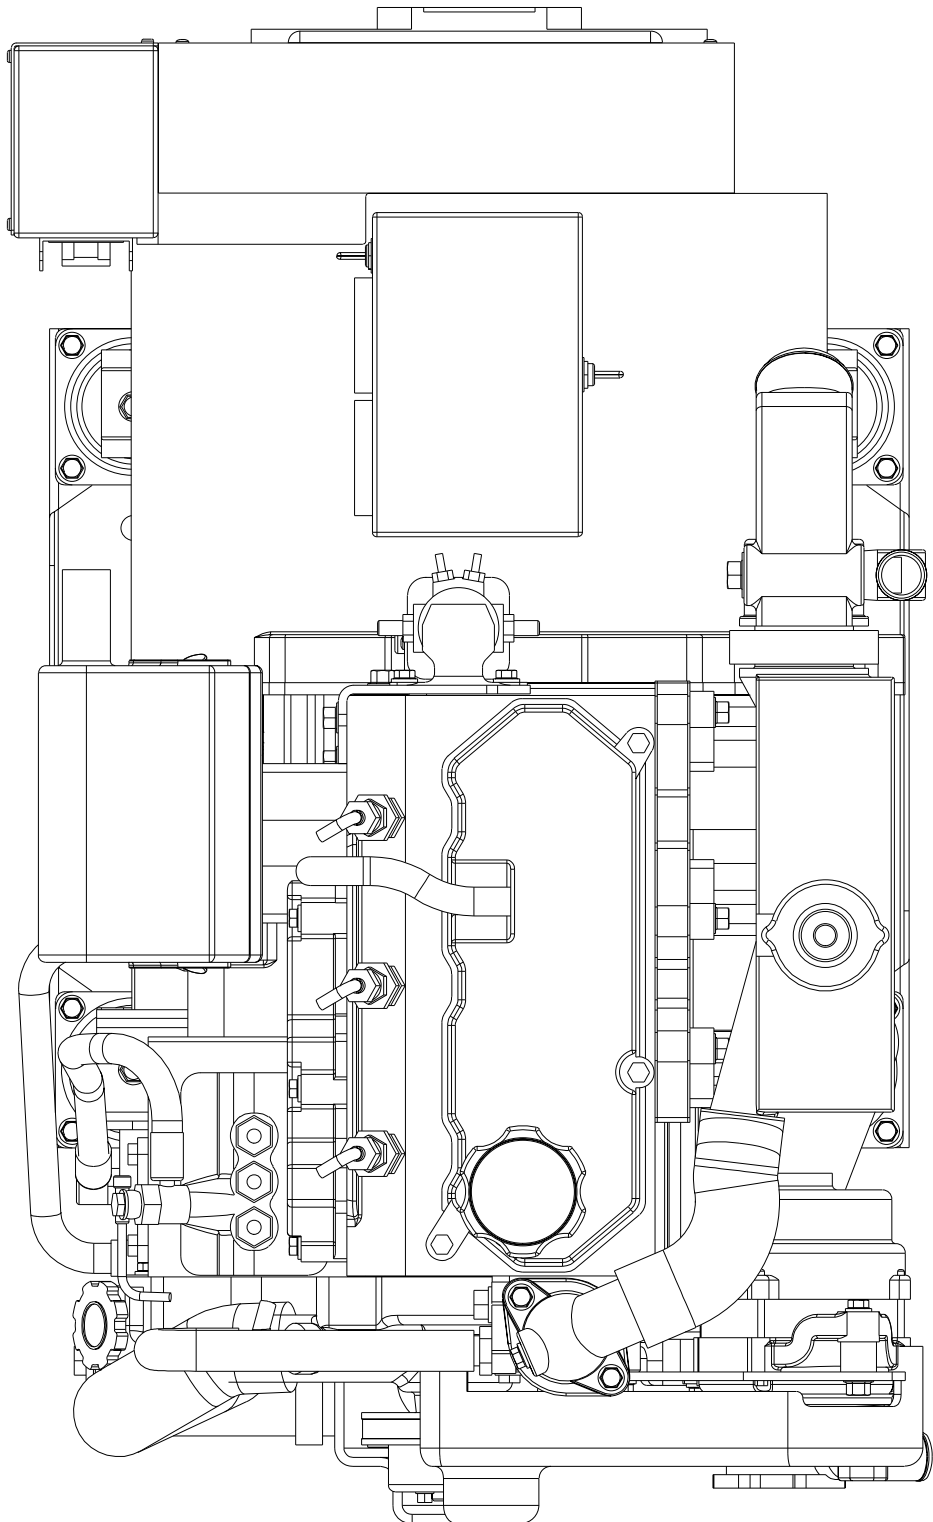

TOLERANCES			WESTERBEKE CORPORATION		
(UNLESS OTHERWISE NOTED)			AVON, MA. 02322		
INCHES	MILLIMETERS	TITLE	INSTALLATION DRAWING		
XX ± .02	XX ± .5		10 KW. B7DA		
CAST ± .03	XX ± .5		(AI)		
ANGLES ± .5°					
FINISH 5/					
DIMENSIONS			DRAWN BY JM	DATE 9-18-99	MATERIAL -
APPROVED BY			SCALE 1/4	SIZE	DRAWING NUMBER
(WHEN APPLICABLE)			SHT. 1 OF 1	D	44197
					REV. A

MODEL WITH 50 AMP ALTERNATOR